


RESIDENTIAL SIDEWALK & DRIVEWAY STANDARDS FOR NEW CONSTRUCTION

NOTE: ALL CONCRETE MUST BE INDOT CLASS A

USE INDOT CURB RAMP STANDARDS LISTED IN DESIGN MEMORANDUM NO. 04-19

*SIDEWALK WIDTH VARIES DEPENDING ON SUBDIVISION TYPE - USE TITLE 18 DIVISION IV 18.160.090 - 18.160.120 FOR DRIVEWAY STANDARDS

ALL SIDEWALK AND DRIVEWAY APPROACHES MUST BE INSPECTED BEFORE POURING. CALL THE STREET COMMISSIONER THE DAY BEFORE TO MAKE ARRANGEMENTS 1.260.665.7656.

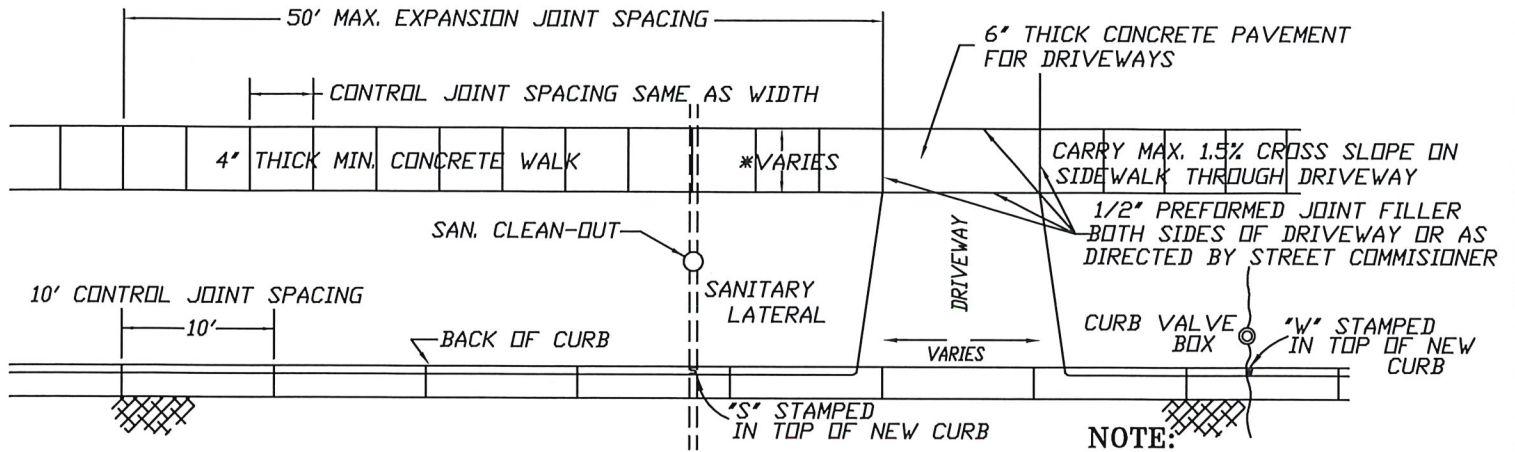


JOINT LOCATIONS - CONCRETE SIDEWALK

N.T.S.


TOP OF CURB TO BE STAMPED "W" OPPOSITE THE CURB VALVE BOX.

TOP OF CURB TO BE STAMPED "S" AT ALL LOCATIONS ABOVE WHERE A SANITARY SEWER LATERAL CROSSES UNDER CURB.

MIN. OF 2" OF COMPACTED NO. 53 STONE AGGREGATE IN FILL AREAS OR IN AREAS WHERE UNSTABLE SOILS ARE ENCOUNTERED OR AS DIRECTED BY THE CITY ENGINEER.

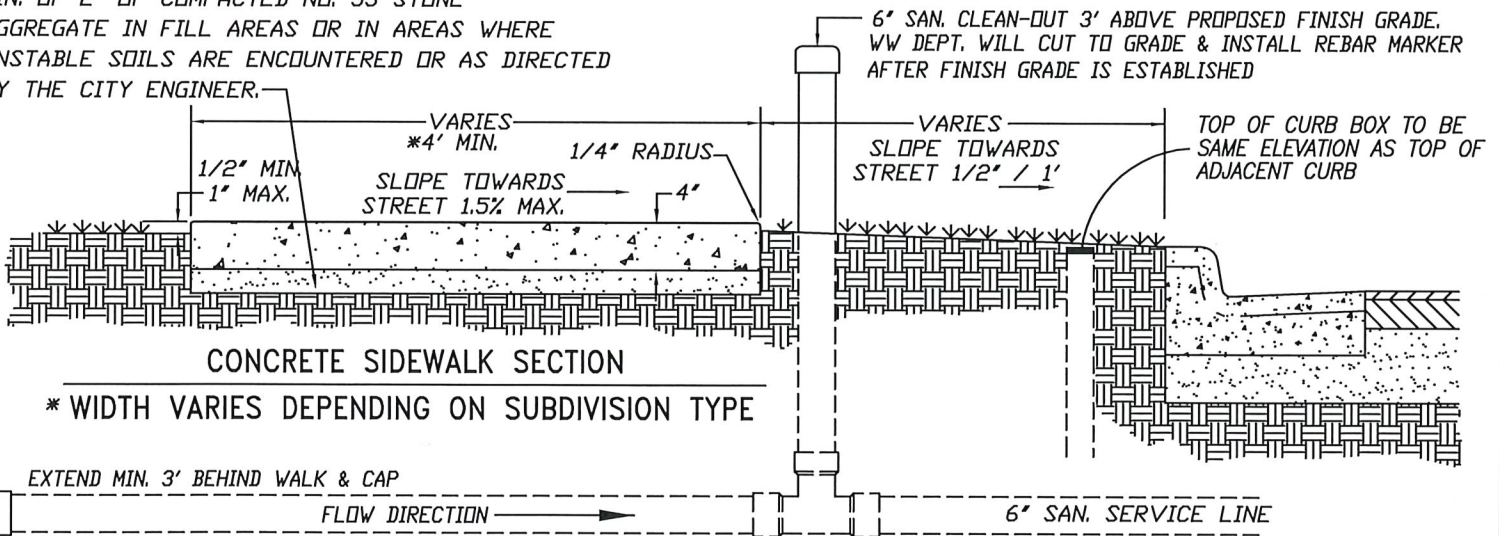


MIN. OF 2" OF COMPACTED NO. 53 STONE AGGREGATE IN FILL AREAS OR IN AREAS WHERE UNSTABLE SOILS ARE ENCOUNTERED OR AS DIRECTED BY THE CITY ENGINEER.

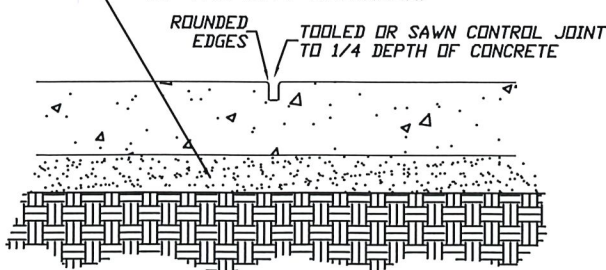

TYPICAL CONTROL JOINT - SIDEWALK

N.T.S.

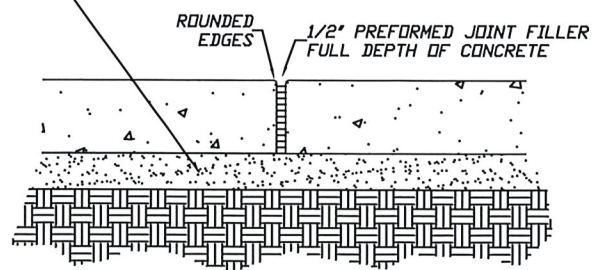

TYPICAL EXPANSION JOINT - SIDEWALK

N.T.S.